


| | | | |
|---|--|---------------------------------------|--|
| JOB NAME: LEFT RAIL, ADJACENT OPENING | | DRAWING NUMBER: REMI-5 14 SQ FT | |
|---|--|---------------------------------------|--|

NOTES:

- (A) 1/4" THICK MAXIMUM TRIM TO BE INSTALLED ON BACKSIDE OF LANDING DOOR FRAMES
- (B) LANDING DOORS TO BE SOLID CORE (BY OTHERS)
- (C) ALL LANDING DOORS AND JAMB/FRAMES ARE TO BE INSTALLED IN A 2" X 4" WALL CONSTRUCTION (OR EQUIVALENT) OR RECESSED TO THE SHAFT SIDE OF THE WALL IN A LARGER WALL CONSTRUCTION. THIS IS MANDATORY TO COMPLY WITH THE 3" X 5" RULE, PER ANSI A17.1; PART 5.3 PRIVATE RESIDENCE ELEVATORS (RULE 5.3.1.4.2). IF CONSTRUCTION OF THE LANDING DOOR WALL(S) IS GREATER THAN 2" X 4" CONSTRUCTION CONSULT WITH ELEVATOR MANUFACTURER PRIOR TO FRAMING AND INSTALLATION OF DOOR JAMB/FRAMES.
- (D) MINIMUM, ADJACENT CORNER RETURN TO BE 12" OR GREATER FOR GATE STACK
- (E) MINIMUM, NON-ADJACENT CORNER RETURN TO BE 9" FOR GATE STACK

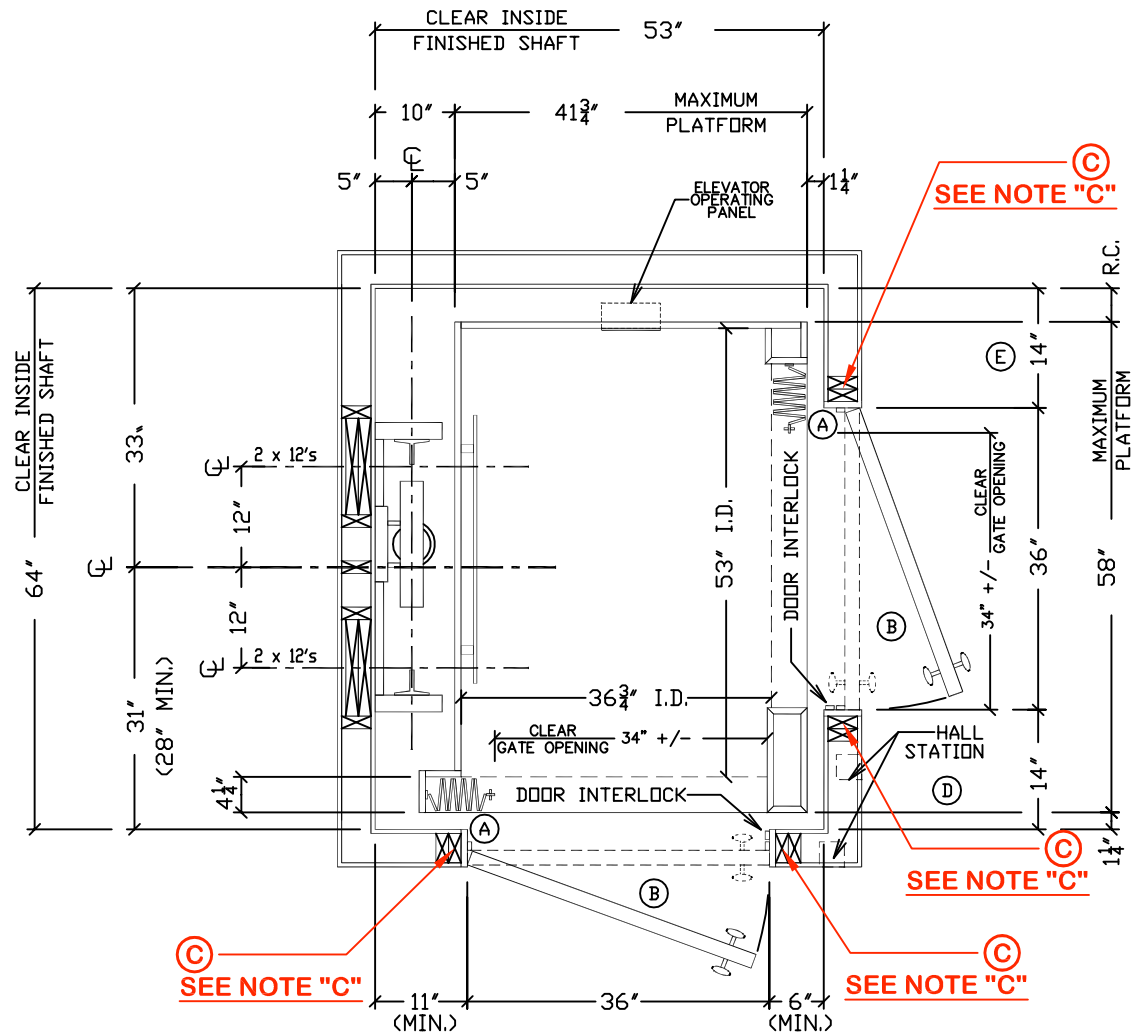

HOISTWAY PLAN VIEW

SCALE - NOT TO SCALE

NOTE: ALL DIMENSIONS ARE APPROXIMATE

DRAWING/ REVISION(S)

| DRAWN: | CHECKED: | DATE: | DESCRIPTION |
|--------|----------|----------|-------------|
| C.J.S. | C.J.S. | 03/01/09 | NEW DRAWING |
| | | | |
| | | | |